



# DFES – DBA Fire Alarm Monitoring ASE III Terminal Strip

ASE III MANDATORY TERMINAL STRIP

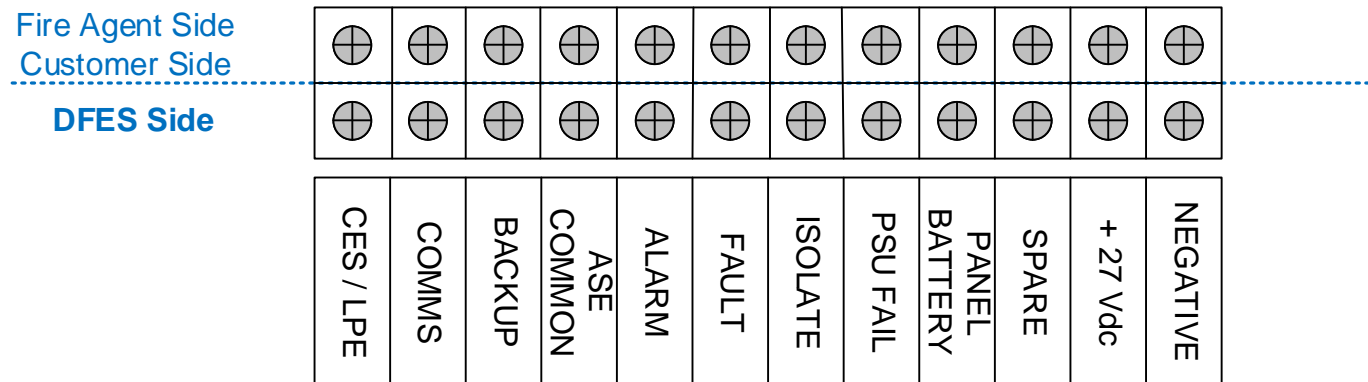

ASE III AVAILABLE TERMINALS

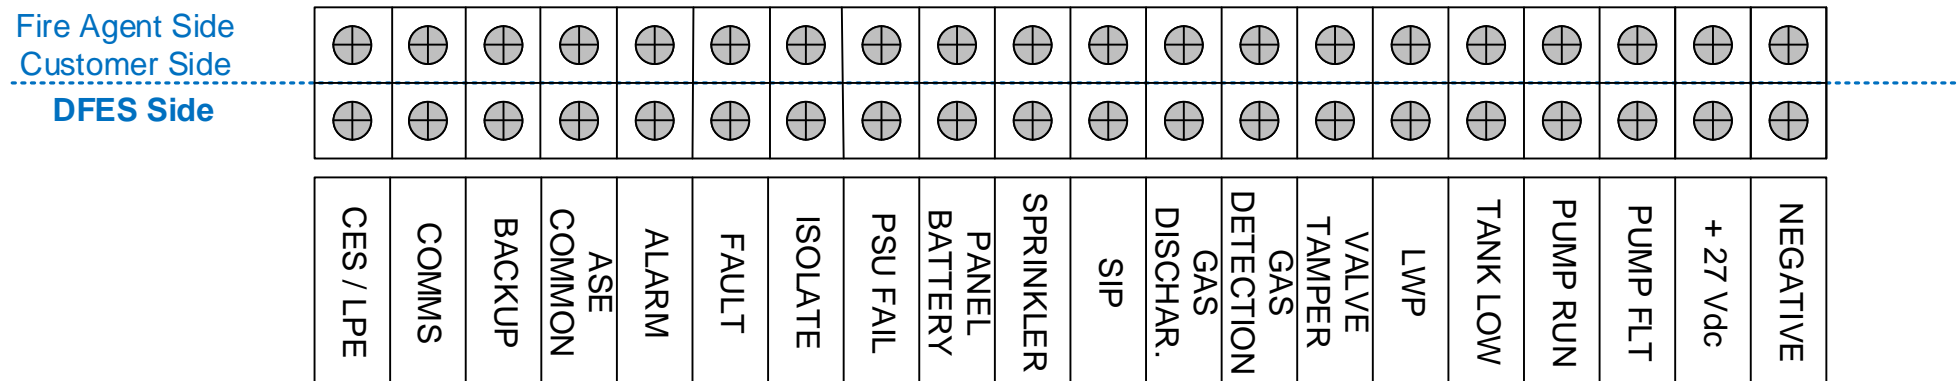

- **ASE** – Alarm Signalling Equipment
- **ASE COMMON** – To be connected to COM on FIP Relay Outputs used for signaling
- **BACKUP COMMS** – Backup Communication Line
- **CES** – Communications Earth System
- **DBA** – Direct Brigade Alarms
- **DFES** – Department of Fire & Emergency Services of WA
- **FIP** – Fire Indicator Panel
- **Fire Agent** – Personnel Servicing Fire Detection System (Customer Equipment) FIP, Sprinkler, ect
- **LPE** – Lightning Protection Earth
- **LWP** – Low Water Pressure
- **SIP** – Sub Indicator Panel
- **SPARE** – Spare Input

		DWG Title	
		CodeRed ASE III	
		Terminal Strip	
		DWG NO. CCR2010DO0001	
DRAWN	Denis Orozovic	DATE	19/08/2010
CHECKED	Denis Orozovic	DATE	24/12/2019
APPROVED		DATE	
		JOB NO.	492
		REV NO.	4.0
		SHEET 1 OF 1	
		REV DATE 21/12/2019	
		FILE	