



DFES – DBA Fire Alarm Monitoring ASE III PSTN Installation

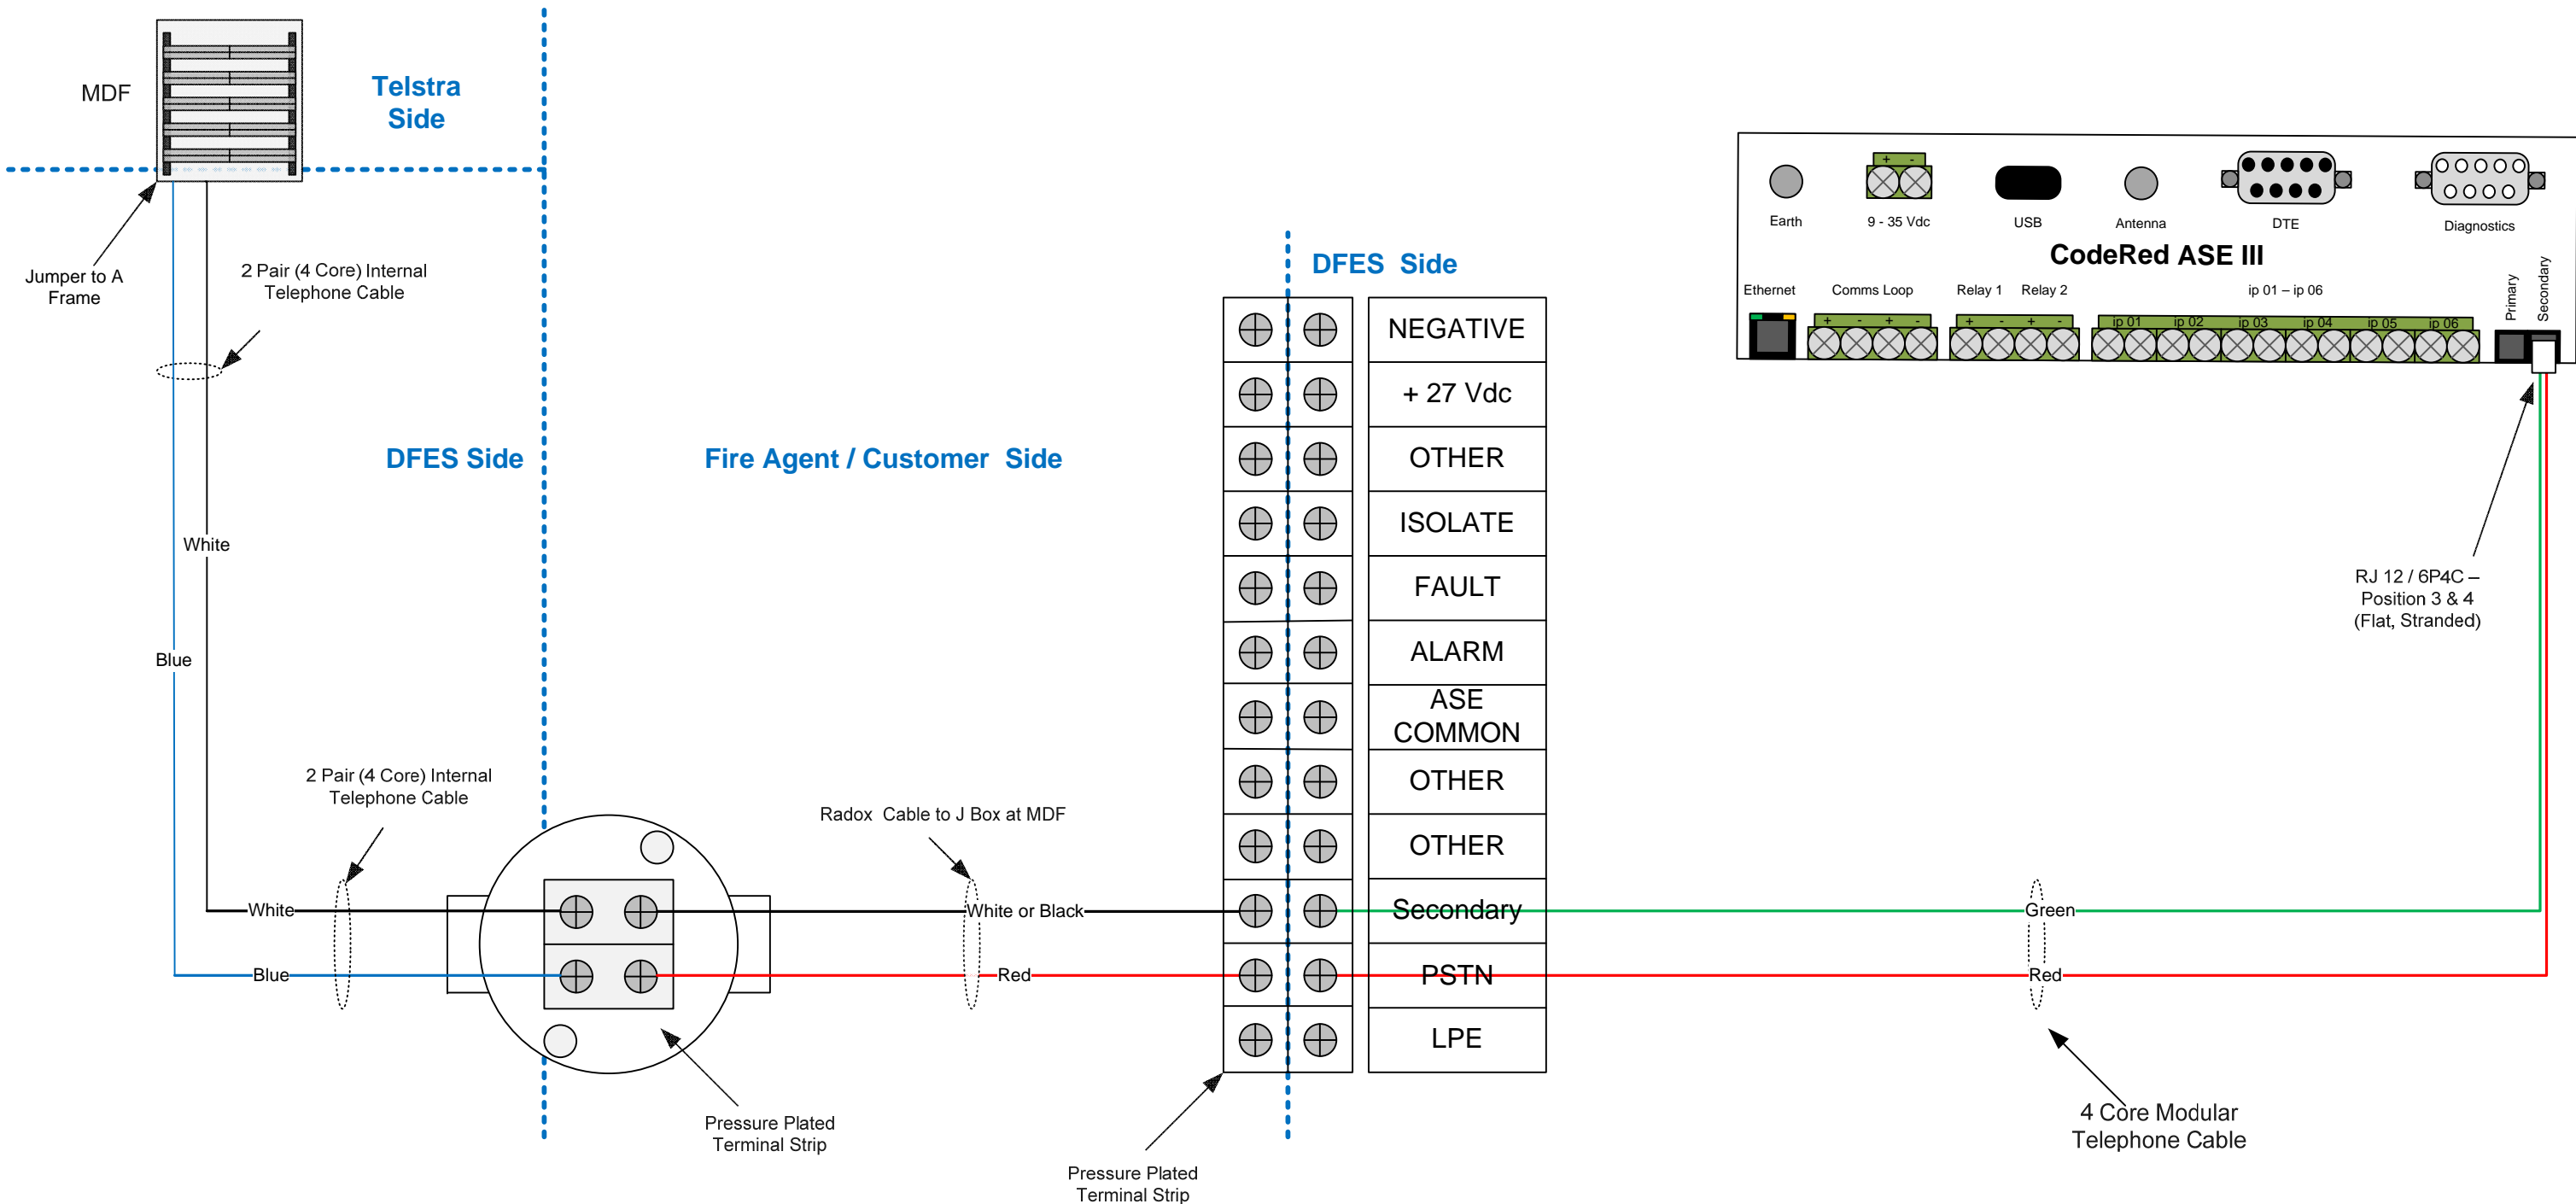

Please Note:
 The J-Box shall be mounted within 500 mm of the MDF to allow for DFES connection. Additionally, there must be at least 200 mm of tail left in the J-Box for use by the DFES contractor. Also the external insulation must be stripped back, levelled with gland.
 In addition, cable shall not enter J-Box except through the manufacture specified entry points. eg: Not through the rear casing or the lid of the J-Box. The J-Box must use opposite entry points, not 90 degree, each entry point shall be 20mm threaded.

		DWG Title	
		CodeRed ASE III	
		PSTN Installation	
PSTN		DWG NO. CCR2010DO0005	
DRAWN	Denis Orozovic	DATE	20/08/2010
CHECKED	Denis Orozovic	DATE	06/03/2014
APPROVED		DATE	
		JOB NO.	261V
		REV NO.	2.0
		SHEET 1 OF 1	REV DATE 06/03/2014
		FILE	